Please read this Manual carefully before installing and using the product .

JB-FSD-A82E Fire Indicating Panel

[illegible]

[illegible]

[illegible]

[illegible]

[illegible]

[illegible]	[illegible]
[illegible]	[illegible]
[illegible]	[illegible]
[illegible]	[illegible]
[illegible]	[illegible]
[illegible]	[illegible]
[illegible]	[illegible]
[illegible]	[illegible]
[illegible]	[illegible]

[illegible]

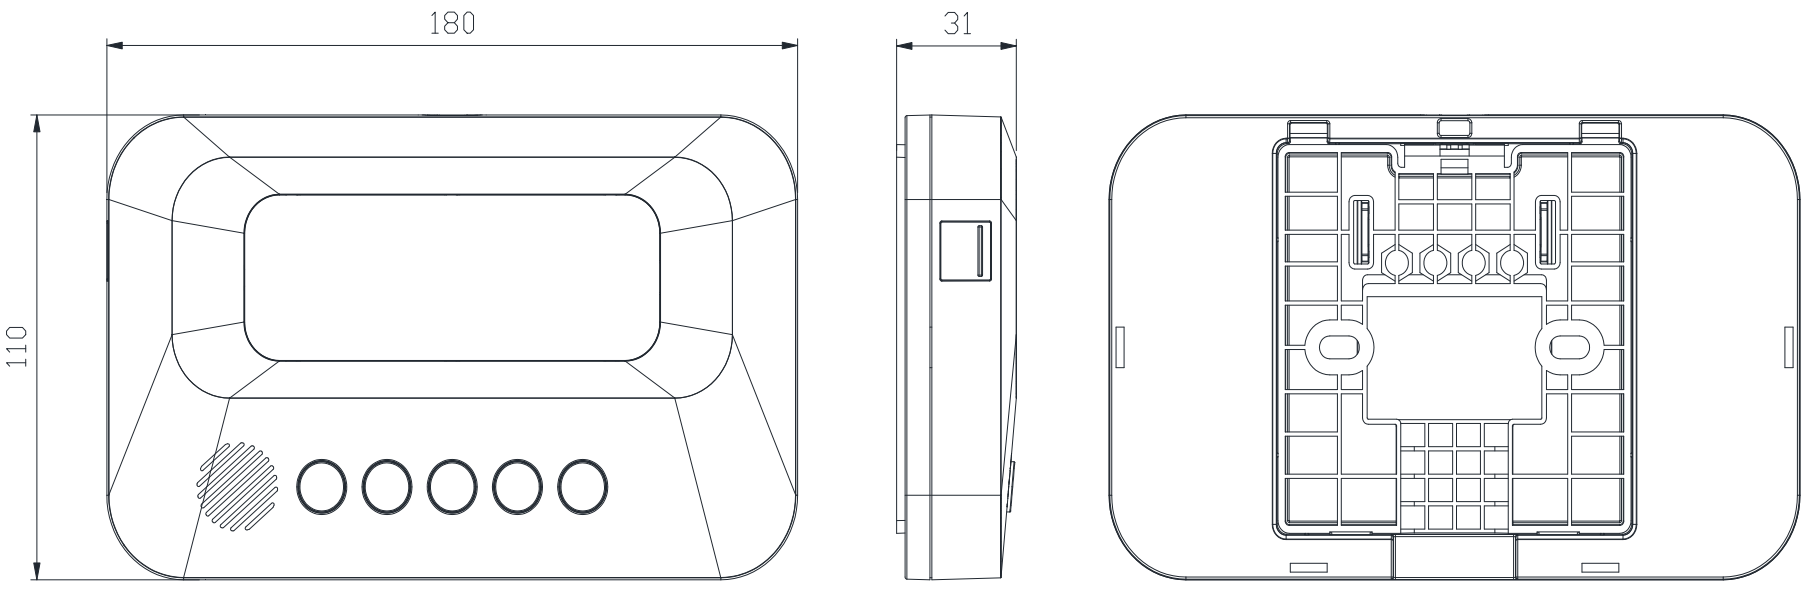

[illegible]

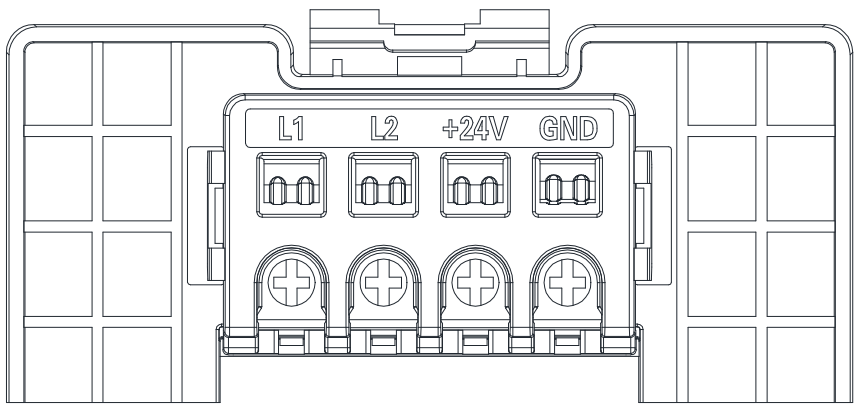
L1
L2
+24V
GND

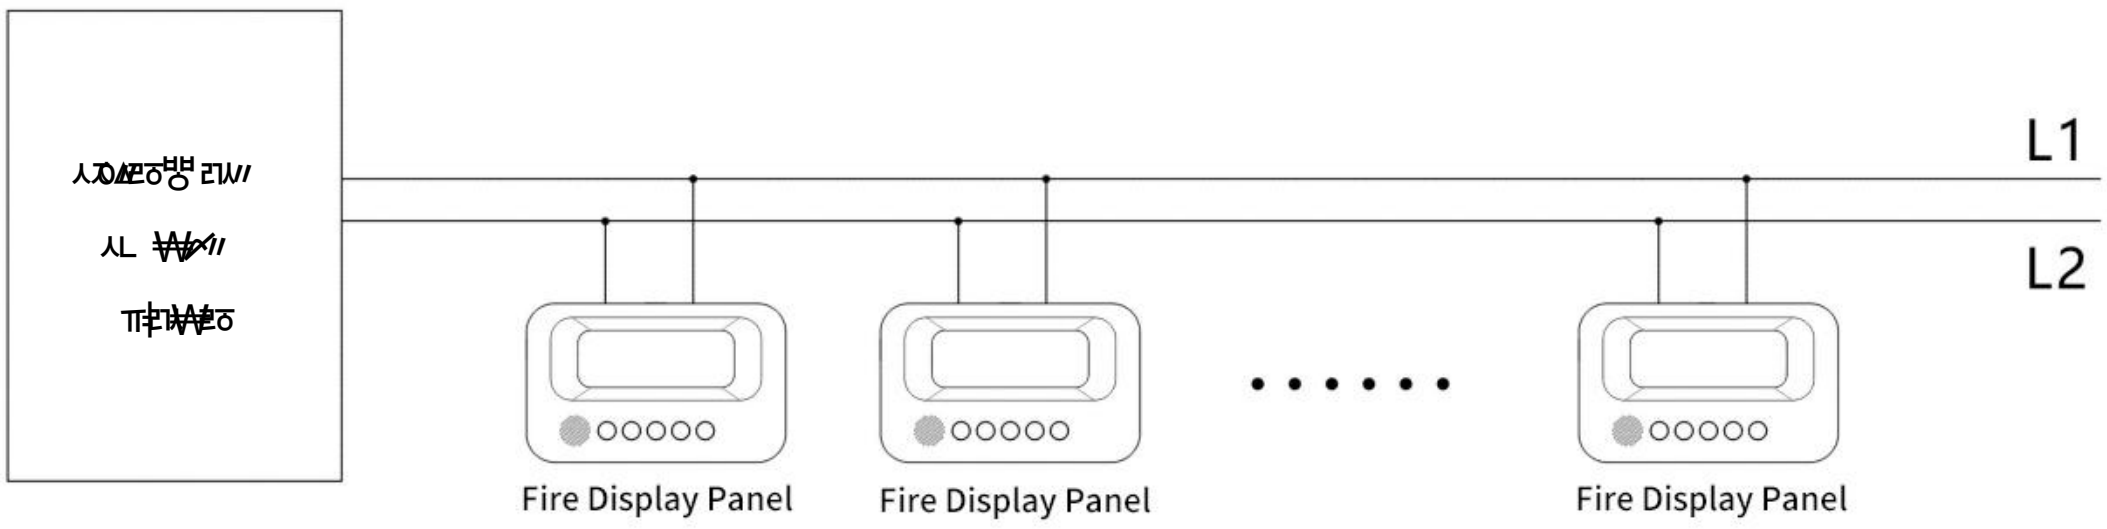
L1
L2
Fire Display Panel
Fire Display Panel
Fire Display Panel

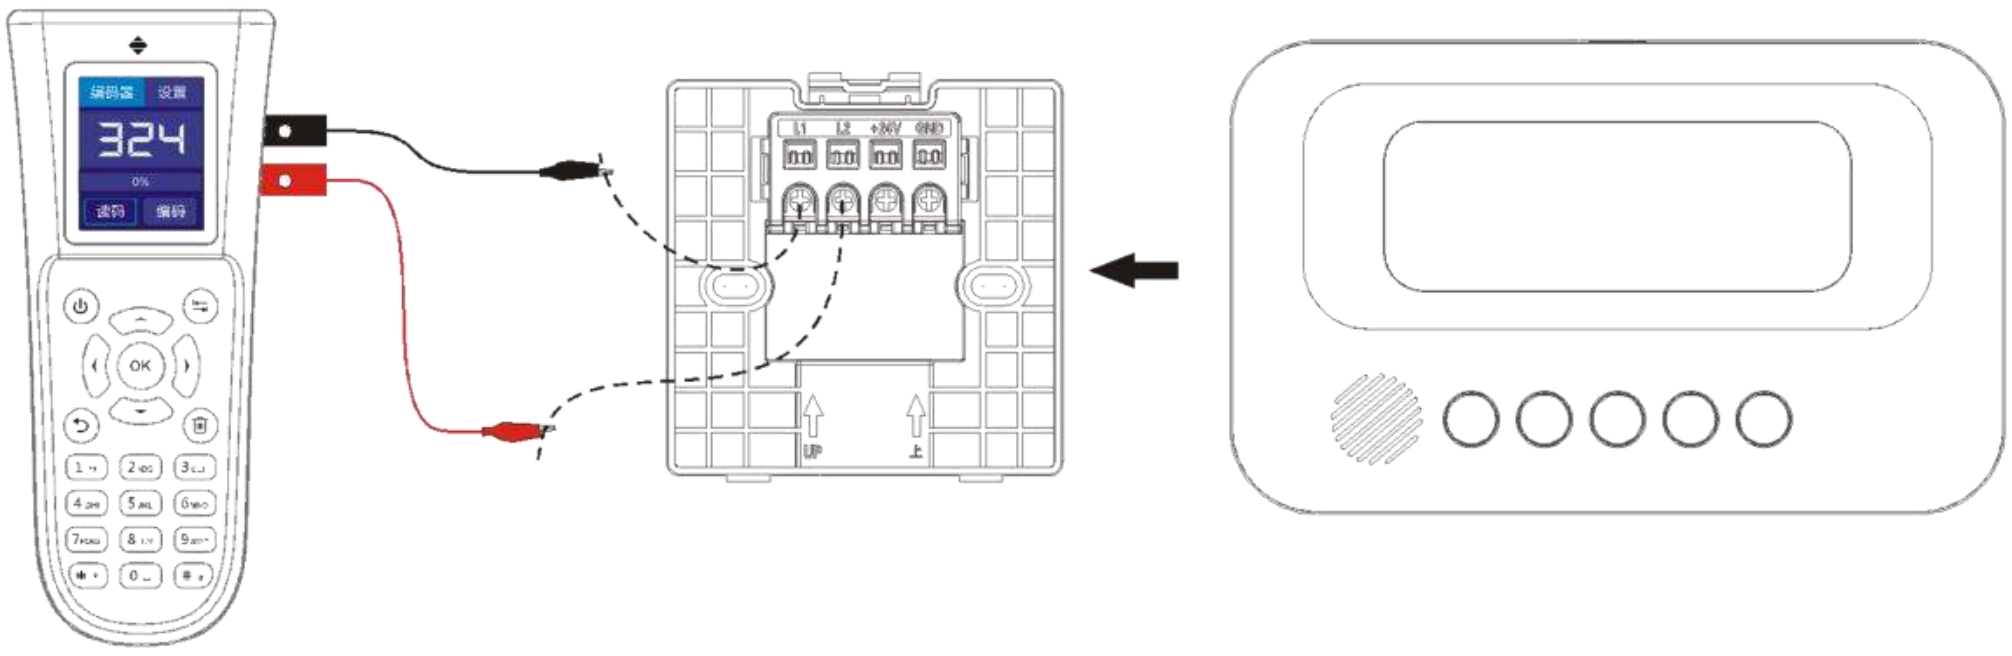
324
OK
L1
L2
+24V
GND
UP

[illegible]	[illegible]	[illegible]
[illegible]	[illegible]	[illegible]
[illegible]	[illegible]	[illegible]
[illegible]	[illegible]	[illegible]
[illegible]	[illegible]	[illegible]
[illegible]	[illegible]	[illegible]

[illegible]

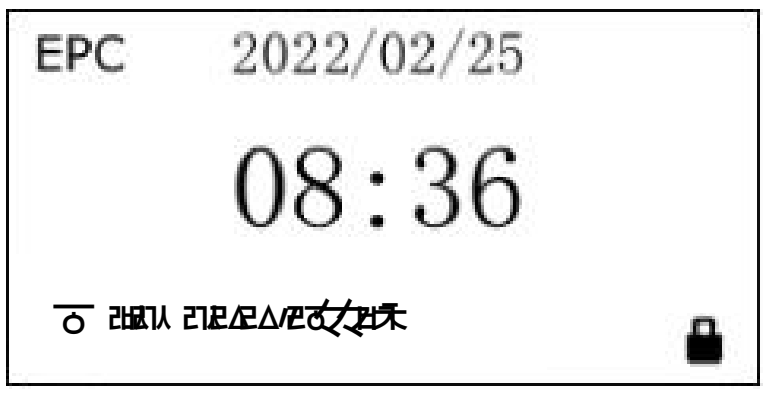
EPC
2022/02/25
08:36

[illegible]

[illegible]

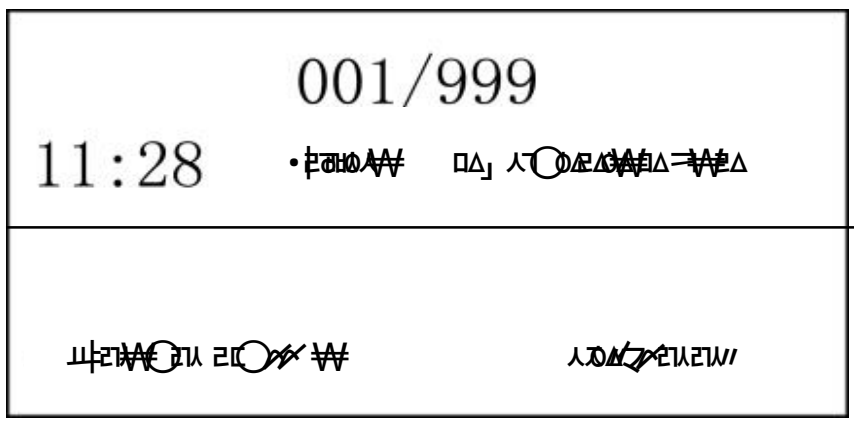
001/999
11:28

[illegible]

[illegible]

[illegible]

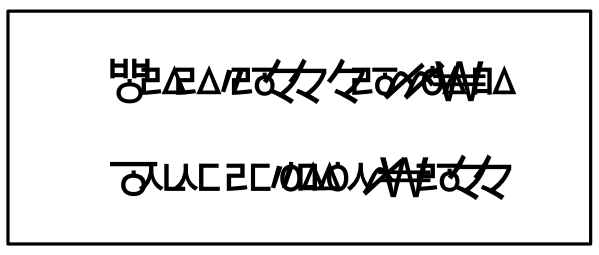

[illegible]

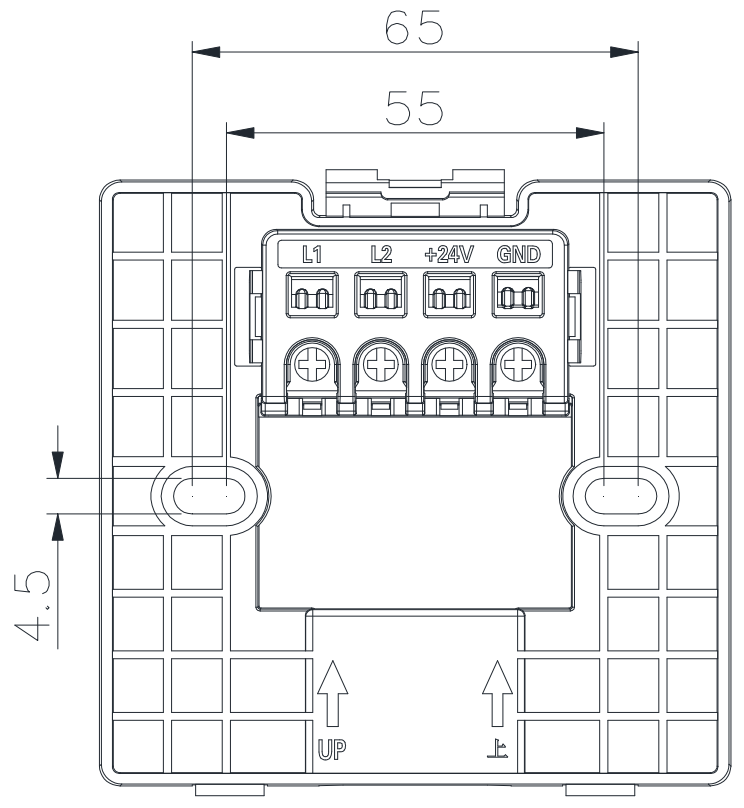
65
55
L1
L2
+24V
GND
4.5
UP
上

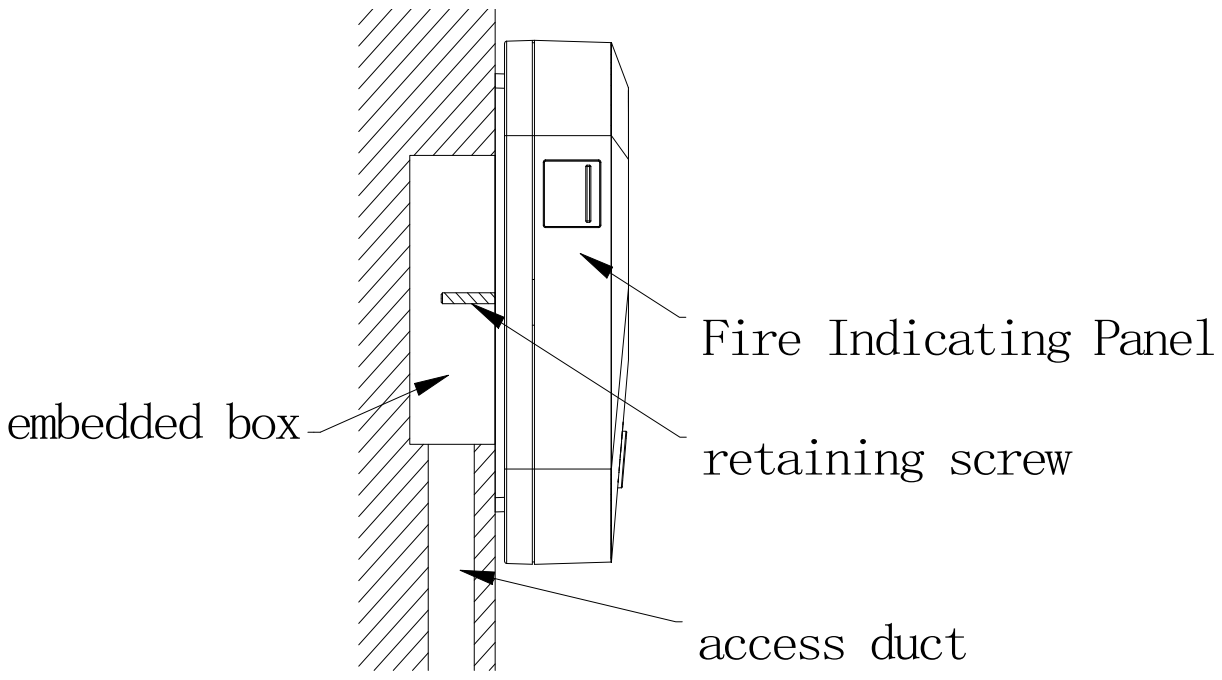
Fire Indicating Panel
embedded box
retaining screw
access duct

SHENZHEN HTI SANJIANG ELECTRONICS CO., LTD.