Please read this Manual carefully before installing and using the product .

JK-A52E Input Module

1 [illegible]

1.1 [illegible]


2 [illegible]

2.1

[illegible]	[illegible]
[illegible]	[illegible]
[illegible]	[illegible]
[illegible]	[illegible]
[illegible]	[illegible]
[illegible]	[illegible]
[illegible]	[illegible]
[illegible]	[illegible]
[illegible]	[illegible]
[illegible]	[illegible]
[illegible]	[illegible]

3 [illegible]

3.1

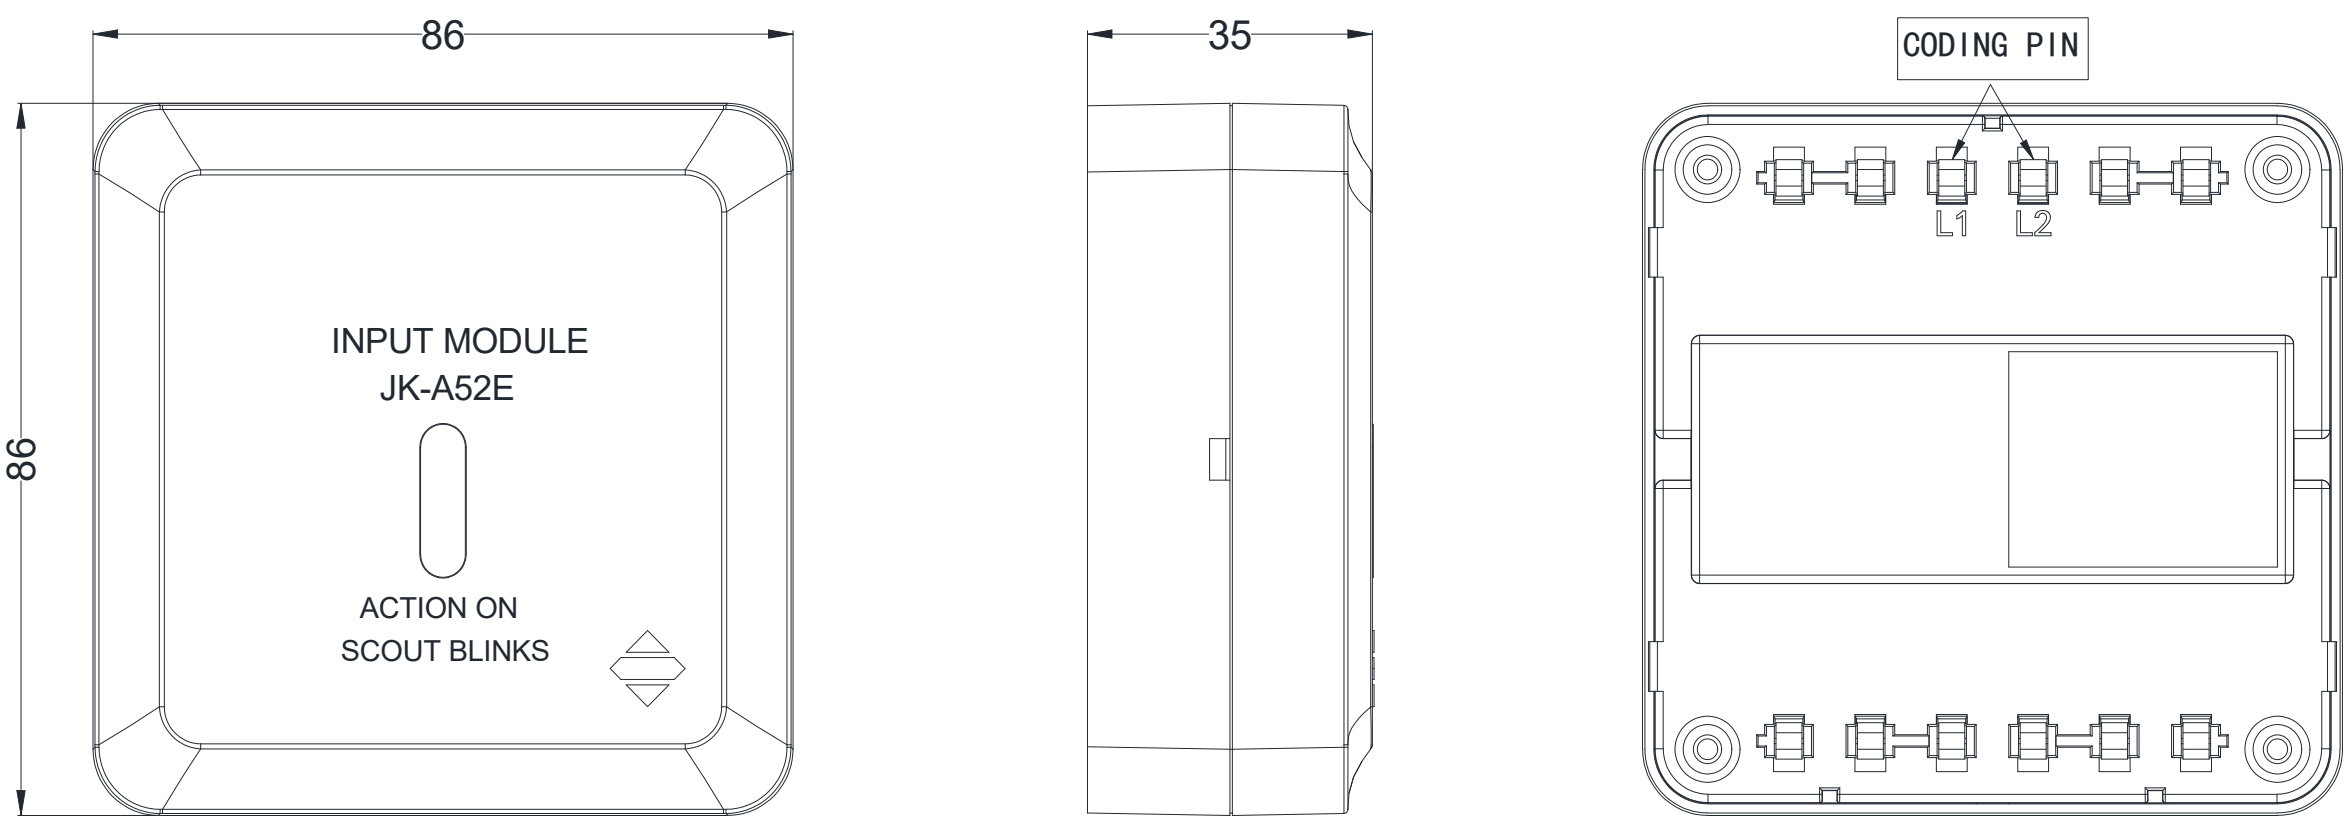

[illegible]

4 [illegible]

4.1 [illegible]

[illegible]

[illegible]	[illegible]	[illegible]	[illegible]
[illegible]	[illegible]	[illegible]	[illegible]
[illegible]	[illegible]	[illegible]	[illegible]

86
17
UP
D2 D1 L2 L1
60
86
TO+ TO-
DZ-A52

L1
L2
24V
GND
L1
L2
TO+
JK-A52E
Module
D2
TO-
D1
Addressable
Fire Alarm
Control Panel
3
Detector 2
1
3
Detector 2
1
End Of Line
Resistor
4.7K

L1
L2
24V
GND
L1
L2
TO+
JK-A52E
Module
D2
TO-
D1
Addressable
Fire Alarm
Control Panel
3
manual
call point
2
1
3
manual
call point
2
1
End Of Line
Resistor
4.7K